


THIS BURIED ELECTRONIC MARKER IS TO BE USED FOR MARKING THE LOCATION OF CONNECTION POINTS, T-TAPS, MOLE ASSEMBLIES, CONDUIT STUB-OUTS OR OTHER LOCATIONS WHICH MAY NEED TO BE LOCATED AT SOME TIME IN THE FUTURE.

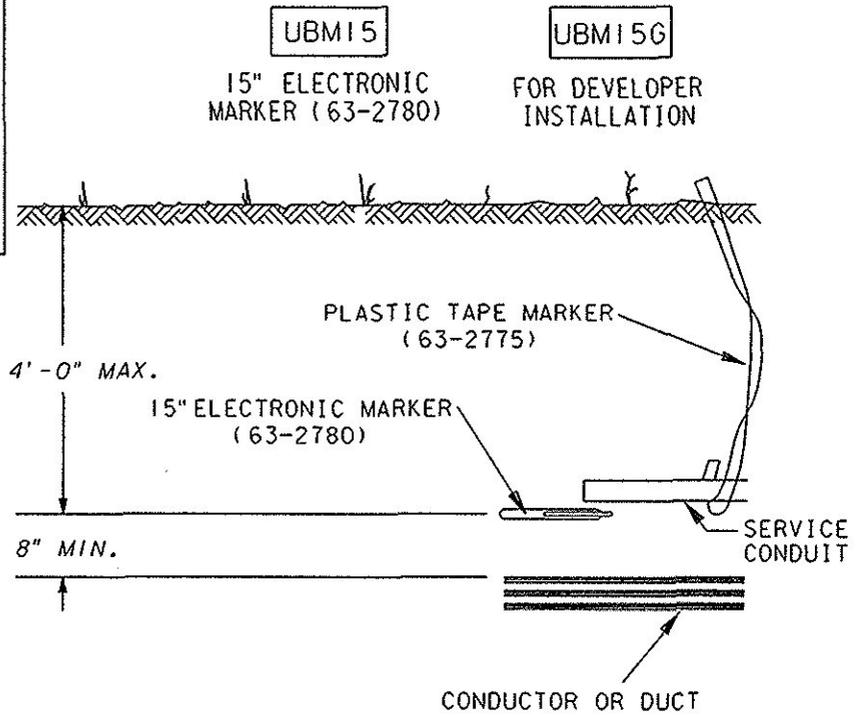


NOTES

1. BURY AT LEAST 8" ABOVE ENERGIZED CONDUCTOR. CLOSER DISTANCE WILL CAUSE THE MARKER TO BE INEFFECTIVE AT 4 FOOT OR GREATER DEPTH.
2. THE MARKER IS TO BE BURIED FLAT AND LEVEL, BALL TYPES ARE SELF-LEVELING.
3. COVER WITH AT LEAST 4" OF SELECT BACKFILL TO PREVENT ACCIDENTAL MOVEMENT OR DAMAGE DURING BACKFILL. (FOR SERVICE CONDUIT, IT MAY BE IN BOTTOM OF TRENCH).
4. CARE SHOULD BE TAKEN TO INSURE THAT CABLE, TIN FOIL, OR OTHER EXTRANEOUS METAL DOES NOT GET DISCARDED INTO THE TRENCH PRIOR TO BACKFILL. METAL IN CLOSE PROXIMITY WILL RENDER THE MARKER INEFFECTIVE.
5. FOR PERMANENT INSTALLATION WITH A BURIED JUNCTION BOX: DRILL 2 HOLES IN LID AND SECURE MARKER TO LID WITH NYLON CABLE TIE.

UBM8
8" ELECTRONIC MARKER (63-2778)

UBM8G
FOR DEVELOPER INSTALLATION

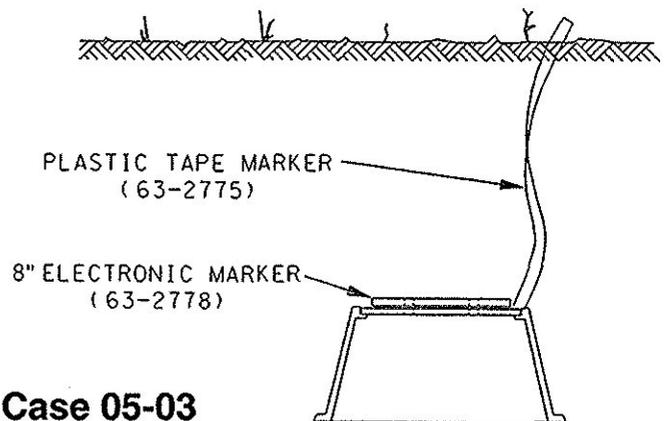

Case 05-03
SRP INFORMATION
August 3, 2005
Page 1 of 4

UNDERGROUND DISTRIBUTION CONSTRUCTION STANDARDS  PROPRIETARY MATERIAL	UNDERGROUND BASIC ASSEMBLY UNITS PLACEMENT STANDARD FOR BURIED ELECTRONIC MARKER	REV. FORMAT 8513E115.DGN
	UBM8 - UBM15	DATE: 01/15/87 REV. NO: 6 REV. DATE: 02/04/02 APPROVAL:
	1-204	

SRP Stock No.


0632780

Compatible Unit

UBM
UBM15
UK25ECPM
UWBGRD1
UWBGRD2
UWBGRD3
UWM4UTX40K

Description

Noun MARKER
Adjective BURIED ELECTRONIC
Size 15" DIA., 1" THICK
Type A TUNED PASSIVE ELEMENT
Style HERMETICALLY SEALED
Use TO MARK SUBSURFACE FACILITIES

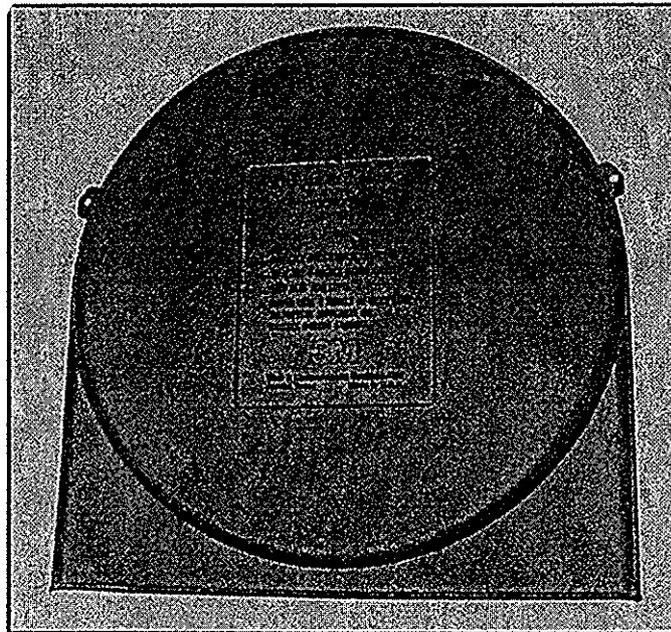

Approved Suppliers

3M CO

Part Number

1251

Case 05-03
SRP INFORMATION
August 3, 2005
Page 2 of 4

Electric Service Specifications  PROPRIETARY MATERIAL	MISCELLANEOUS CONTRACTOR-SUPPLIED MATERIAL BURIED ELECTRONIC MARKER 15" DIA., 1" THICK, SRP STOCK NO. 0632780	10-41.doc DATE: 03-30-05 REV. NO.: 0 REV. DATE: APPROVAL: MLD
		10-41

SRP Stock No.

0632778

Description

Noun MARKER

Adjective BURIED ELECTRONIC

Size 8.25" DIA.


Type A TUNED PASSIVE ELEMENT

Style HERMETICALLY SEALED

Use ATTACHED TO TEMPORARY CAP (SEE PG. 10-40)

Compatible Unit

- UBML
- UBM8
- ULF5
- ULF6
- ULF7
- UVPB1
- UVPB1K
- UWTNR
- UWTWR

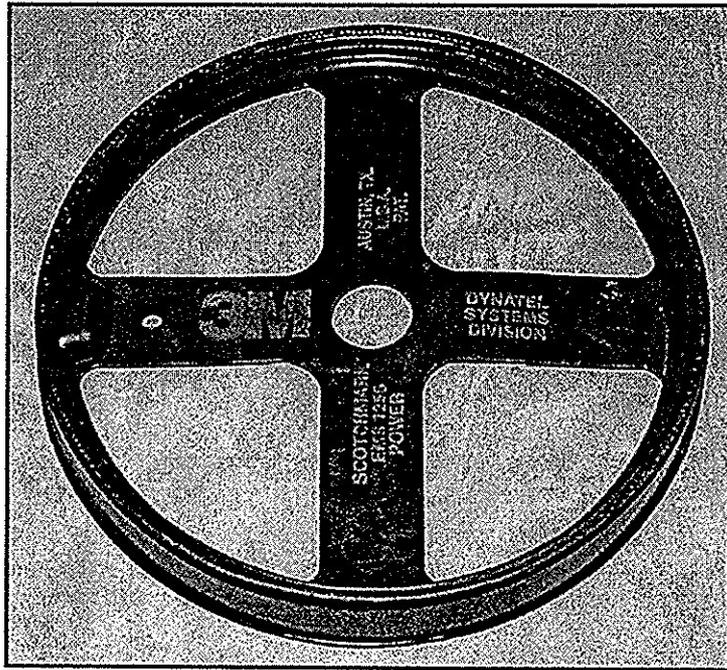

Approved Suppliers

3M

Part Number

1256

**Case 05-03
SRP INFORMATION**

August 3, 2005

Page 3 of 4

10-42.doc DATE: 04-26-05 REV. NO.: 0 REV. DATE: APPROVAL: MLD	MISCELLANEOUS CONTRACTOR-SUPPLIED MATERIAL BURIED ELECTRONIC MARKER 8.25" DIAMETER, SRP STOCK NO. 0632778	Electric Service Specifications 
10-42	PROPRIETARY MATERIAL	

SRP Stock No.

0632775

Description

Noun MARKER

Adjective RED

Size 7' 4" LONG

Type PLASTIC

Style BURIED CABLE

Use FLAG ABOVE GROUND ATTACHED TO TEMPORAY CAP (SEE PG. 10-40)

Compatible Unit

MC49

MC50

UMB15

UMB8

UK25ECPM

ULF5

ULF6

ULF7

UWM4UTX40K

Approved Suppliers

RADAR ENG. PROD

Part Number

600

**Case 05-03
SRP INFORMATION**

August 3, 2005

Page 4 of 4

Electric Service Specifications  PROPRIETARY MATERIAL	MISCELLANEOUS CONTRACTOR-SUPPLIED MATERIAL MARKER, RED, 7' 4" LONG SRP STOCK NO. 0632775	10-43.doc DATE: 04-22-05 REV. NO.: 0 REV. DATE: APPROVAL: MLD
		10-43